MODEL CODE BREAKDOWN

(F3) - ** VQ * * A * - * * * 20 (*)

1 2 3 4 5 6 7 8 9 10

SAE RATED CAPACITY
(RATING AT 1200 RPM – 100 PSI)

SEE CAPACITY (USGPM) – SEE TABLE INSIDE

5 PORT CONNECTIONS

		OICE COMMEDCIA
CODE	INLET CONNECTION	OUTLET CONNECTION
A B C D	SAE 4-BOLT SAE STR. THD. SAE 4-BOLT SAE STR. THD.	SAE 4-BOLT SAE STR. THD. SAE STR. THD. SAE 4-BOLT

6 MOUNTING & SHAFT SEALS ASSY.
F – FOOT (SINGLE SHAFT SEAL ASSY.)
S – FLANGE (DOUBLE SHAFT SEAL ASSY.)
OMITTED – FLANGE (SINGLE SHAFT SEAL ASSY.)


7 SHAFTS
SEE TABLE INSIDE

8 PORT POSITIONS

9 (SEE CHART BELOW)
DESIGN

ROTATION
(VIEWED FROM SHAFT END)

L – LEFT HAND (CCW ROTATION) OMITTED – RIGHT HAND ROTATION

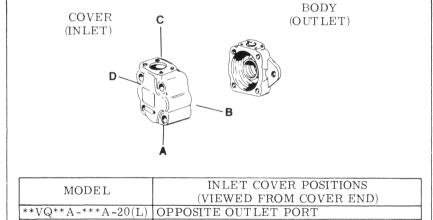

MODEL	INLET COVER POSITIONS	
MODEL	(VIEWED FROM COVER END)	
VQA-***A-20(L) OPPOSITE OUTLET PORT		
VQA-***B-20(L)	-20(L) 90° CLOCKWISE FROM OUTLET	
VQA-***C-20(L) IN-LINE WITH OUTLET		
VQA-***D-20(L)	90° COUNTERCLOCKWISE FROM OUTLET	

PARTS ORDERING



PARTS ARE THE SAME FOR BOTH RIGHT AND LEFT HAND ROTATION. WHEN ORDERING SPARE CARTRIDGE PARTS, IT IS RECOMMENDED THEY BE OBTAINED IN CARTRIDGE KITS. KITS ARE ASSEMBLED AND TESTED FOR EITHER RIGHT OR LEFT HAND ROTATION. IF LEFT HAND ROTATION IS REQUIRED, IT SHOULD BE SPECIFIED ON PARTS ORDER BY ADDING SUFFIX "L" TO KIT NUMBER. FOR EXAMPLE, 416439–L.

For satisfactory service life of these components, use full flow filtration to provide fluid which meets ISO cleanliness code 16/13 or cleaner. Selections from pressure, return, and in-line filter series are recommended.


Litho in U.S.A.

Service Parts Information




Vane Type Single Pump

35VQ**A-86* -20(L) 36VQ**A-86 -20(L)

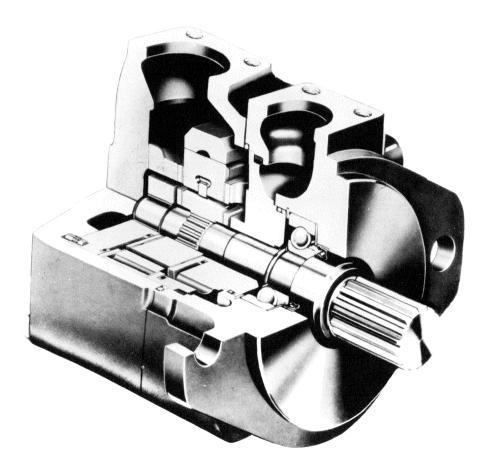

Vickers Incorporated 5445 Corporate Drive P.O. Box 302 Troy, Michigan 48007-0302 U.S.A.

Revised 10-1-89 I-3167-S

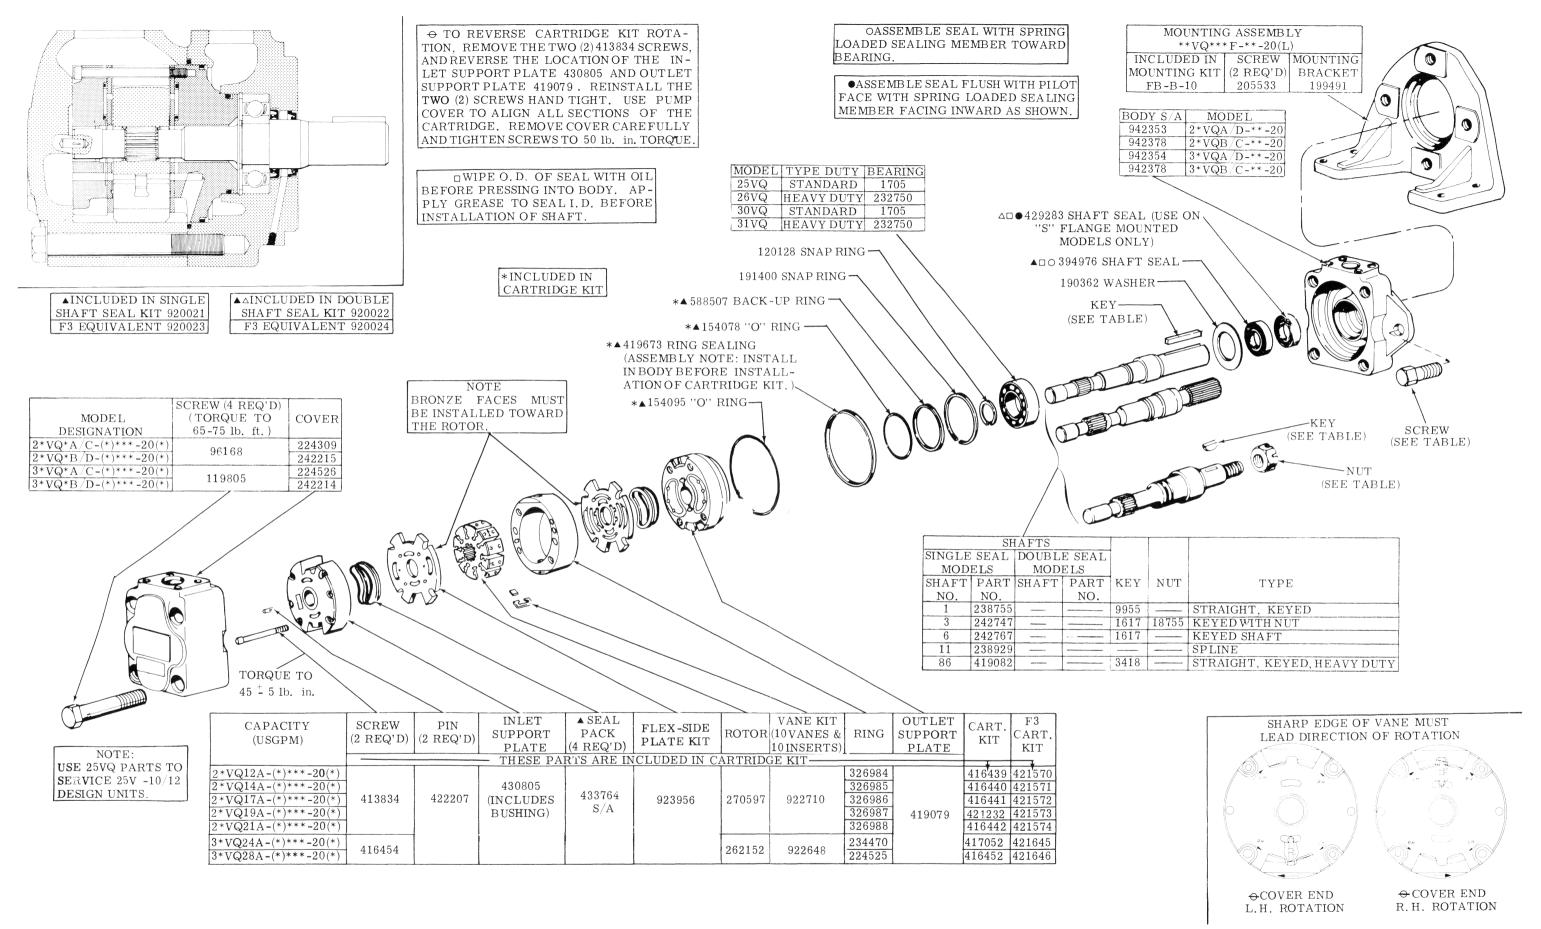

WARNING: USE THIS DRAWING FOR PARTS INFORMATION ONLY. SEE OVERHAUL MANUAL 1-3144-S FOR MAINTENANCE INFORMATION